



FLTC20

EMERGENCY LIGHTING RELAY CONTROL DEVICE

INSTALLATION INSTRUCTIONS

! IMPORTANT SAFEGUARDS !

WHEN USING ELECTRICAL EQUIPMENT, BASIC SAFETY PRECAUTIONS SHOULD ALWAYS BE FOLLOWED, INCLUDING THE FOLLOWING:

READ AND FOLLOW ALL SAFETY INSTRUCTIONS

1. This product is for use with generator-supplied (or central inverter system-supplied) lighting loads. Make sure all connections are in accordance with the National Electrical Code and any local regulations.
2. To reduce the risk of electric shock, disconnect all power sources before servicing.
3. This product is for field installation.
4. This product is for use in indoor or damp locations.
5. An unswitched, normal AC power source (120 through 277 VAC, 50/60 Hz) and a direct, separate connection to a generator-supplied (or central inverter system-supplied) emergency panel are required.
6. The use of accessory equipment not recommended by the manufacturer may cause an unsafe condition.
7. Do not use this product for other than intended use.
8. Servicing should be performed by qualified service personnel.

SAVE THESE INSTRUCTIONS



LISTED

04/12/10

INSTALLATION




CAUTION: THIS UNIT HAS MORE THAN ONE POWER SUPPLY CONNECTION POINT. TO REDUCE THE RISK OF ELECTRIC SHOCK, DISCONNECT ALL POWER SOURCES BEFORE INSTALLING OR SERVICING THIS UNIT.

NOTE: SERVICE BY QUALIFIED PERSONNEL ONLY.

NOTE: BEFORE INSTALLING THE RELAY CONTROL DEVICE, Make sure that the necessary branch circuit wiring is available. An unswitched source of normal power is required. A SEPARATE CONNECTION TO A GENERATOR-SUPPLIED (OR CENTRAL INVERTER SYSTEM-SUPPLIED) CIRCUIT MUST ALSO BE PROVIDED.


1. FAMILIARIZE YOURSELF WITH THESE INSTRUCTIONS BEFORE BEGINNING INSTALLATION.
2. Mount the device in a convenient location using appropriate hardware (not supplied). See Illustration 1 for typical installations. **Do not mount with lid facing down.**

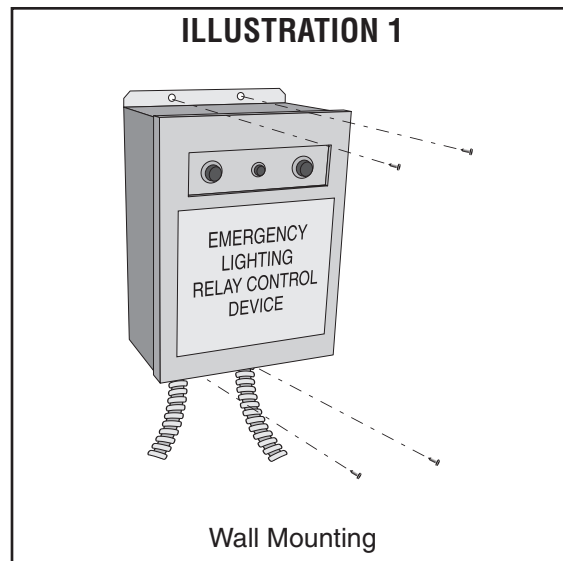

3. Disconnect AC power from all supply circuits.
4. Remove device lid and install necessary conduit and wiring (not supplied) to the device (refer to illustrations 2 to 7 following for proper wiring connections).
- 4a. When using class 2 power limited circuits, remember to keep this wiring separate from high voltage wiring by using separate conduit and the enclosure knockout supplied.
5. Replace device lid and secure.


INSTALLATION

ILLUSTRATION 2

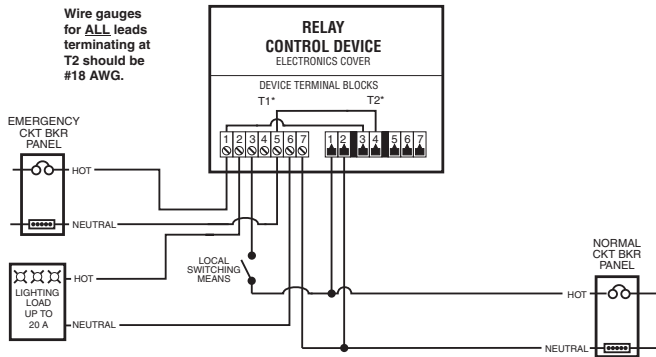


Device as a Generator Transfer Device

ILLUSTRATION 3

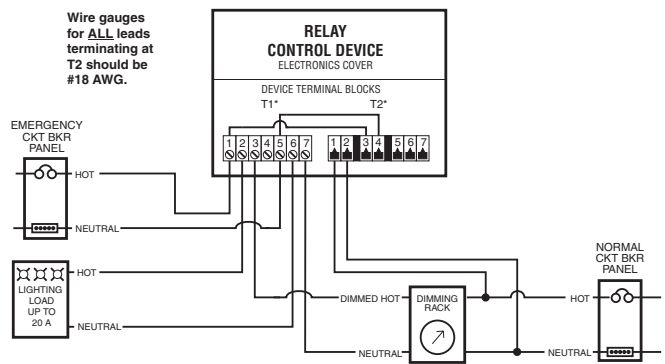


Device as a Generator Transfer Device for a Dimming Rack

ILLUSTRATION 4

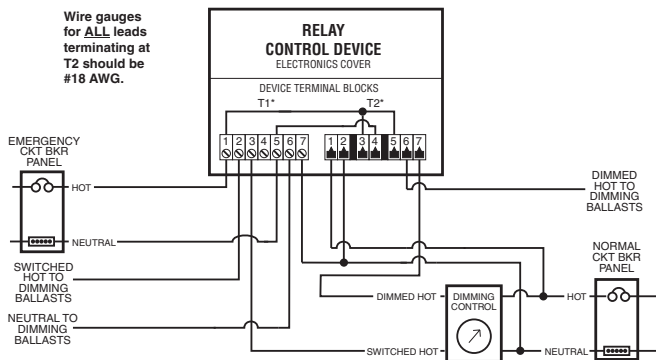


Device as a Generator Transfer Device with a 3-wire Dimming System

ILLUSTRATION 5

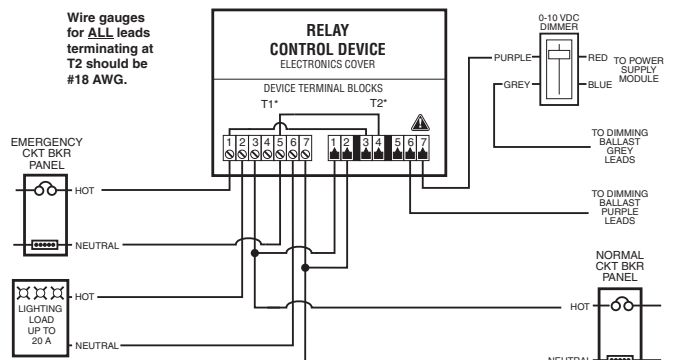


Device as a Generator Transfer Device with a 0-10 VDC Dimming System

ILLUSTRATION 6

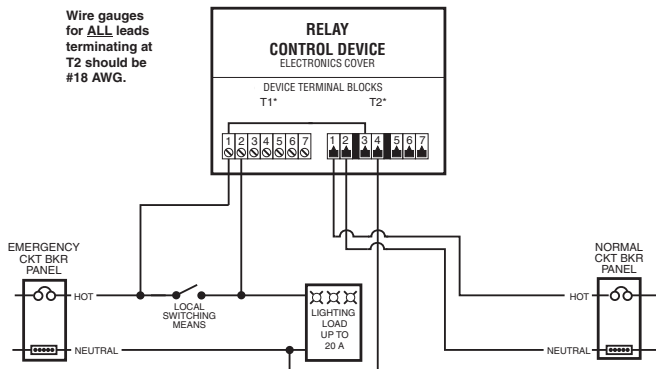

Device as a Switch Bypass Device

ILLUSTRATION 7

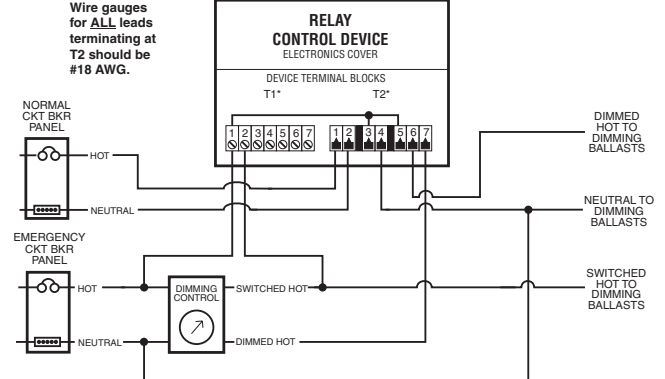

Device as a Switch Bypass Device with a 3-wire Dimming System

***NOTE: WIRE GAUGES FOR ALL LEADS TERMINATING AT T2 SHOULD BE #18 AWG. WIRE GAUGES FOR ALL OTHER CONNECTIONS SHOULD BE SIZED ACCORDING TO TOTAL CONNECTED LIGHTING LOAD. GROUND UNIT USING SUPPLIED GREEN LEAD WIRE. ALL TERMINALS ARE SUITABLE FOR BOTH COPPER AND ALUMINUM WIRE (CU-AL) JUMPERS FROM T1 TO T2 MUST BE INSTALLED BY CONTRACTOR.**

-
6. Mark each designated emergency lighting fixture with the red dot labels provided.
 7. Apply AC power to all circuits. The green "Normal Power Present" and the red "Emergency Power Available" LED's should be illuminated.
 8. Perform a quick test as described on the unit label to check for proper operation. When the test button is depressed, the green "Normal Power Present" LED should extinguish and the controlled lighting load should illuminate regardless of the local switch position provided emergency power is available (check red LED).
 9. During a quick test on a device installed with a dimming system, the fluorescent lighting load should illuminate at full lumen levels when the test switch is depressed regardless of the lumen level during normal operation.
 10. The entire generator (or central inverter) system, including all designated emergency loads, should be exercised to ensure proper operation (e.g., power up the generator, throw the transfer switch to the generator position, and check the emergency loads to verify they are operating properly from the generator supply).

OPERATION

The device uses an internal relay contact to control the AC power feeding the lighting load. When the generator (or central inverter) supplies AC power to the lighting fixture, the device bypasses the local switching means. This ensures the lighting load will be energized during generator (or central inverter) operation regardless of switch position.

MAINTENANCE

No routine maintenance is required to keep the device functional. However, it should be checked periodically to ensure that it is working properly. Note: Make sure to disconnect both the normal and emergency panel circuit breakers before servicing.

! REFER ANY SERVICING INDICATED BY THESE CHECKS TO QUALIFIED PERSONNEL !